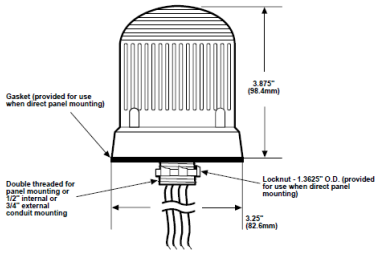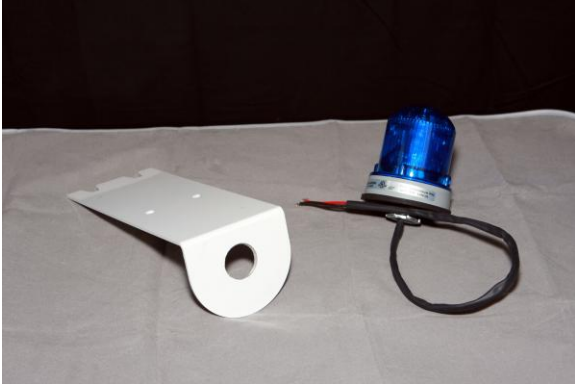# Public Alert Beacon Installation Guide
For Dotworkz D-Series Enclosures
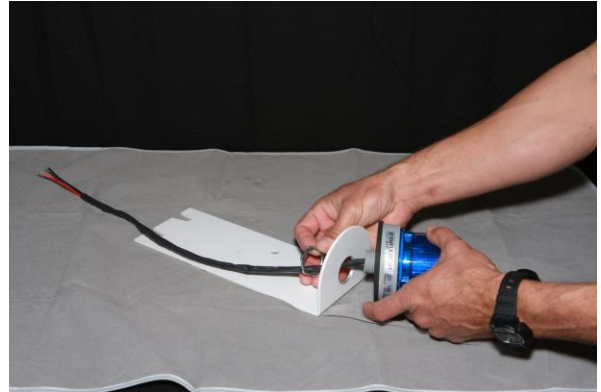
KT-STBB
Low Voltage Beacon Kit

Dimensional Drawings

Gasket (provided for use when direct panel mounting)

3.875" (98.4mm)

Double threaded for panel mounting or 1/2" internal or 3/4" external conduit mounting

Locknut - 1.3625" O.D. (provided for use when direct panel mounting)

3.25" (82.6mm)
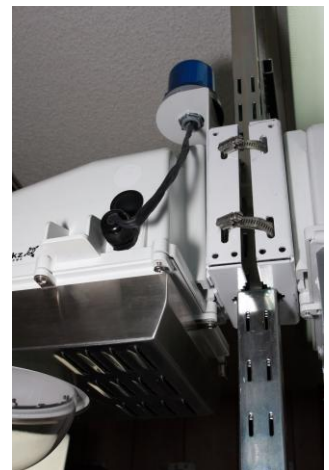
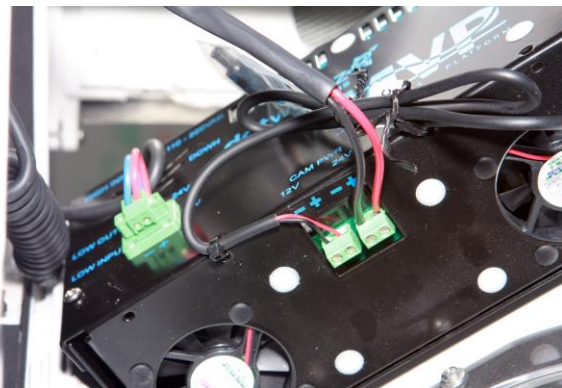Kit Parts

Remove Mounting Nut on bottom, Mount light as shown, re-install and tighten retainer nut

1) Install Lower Mount bolts to bracket or wall   2) Then slide keyhole slots of light bracket in place   3) Install Enclosure on mounts, including remaining top 2 enclosure mount bolts   4) Thread cable thru seal gland making a drip loop with excess wire 5) Tighten gland seal nut to seal wire.

Install Low Voltage wires to appropriate power terminal, observe polarity and color codes

Installed light Kit Example